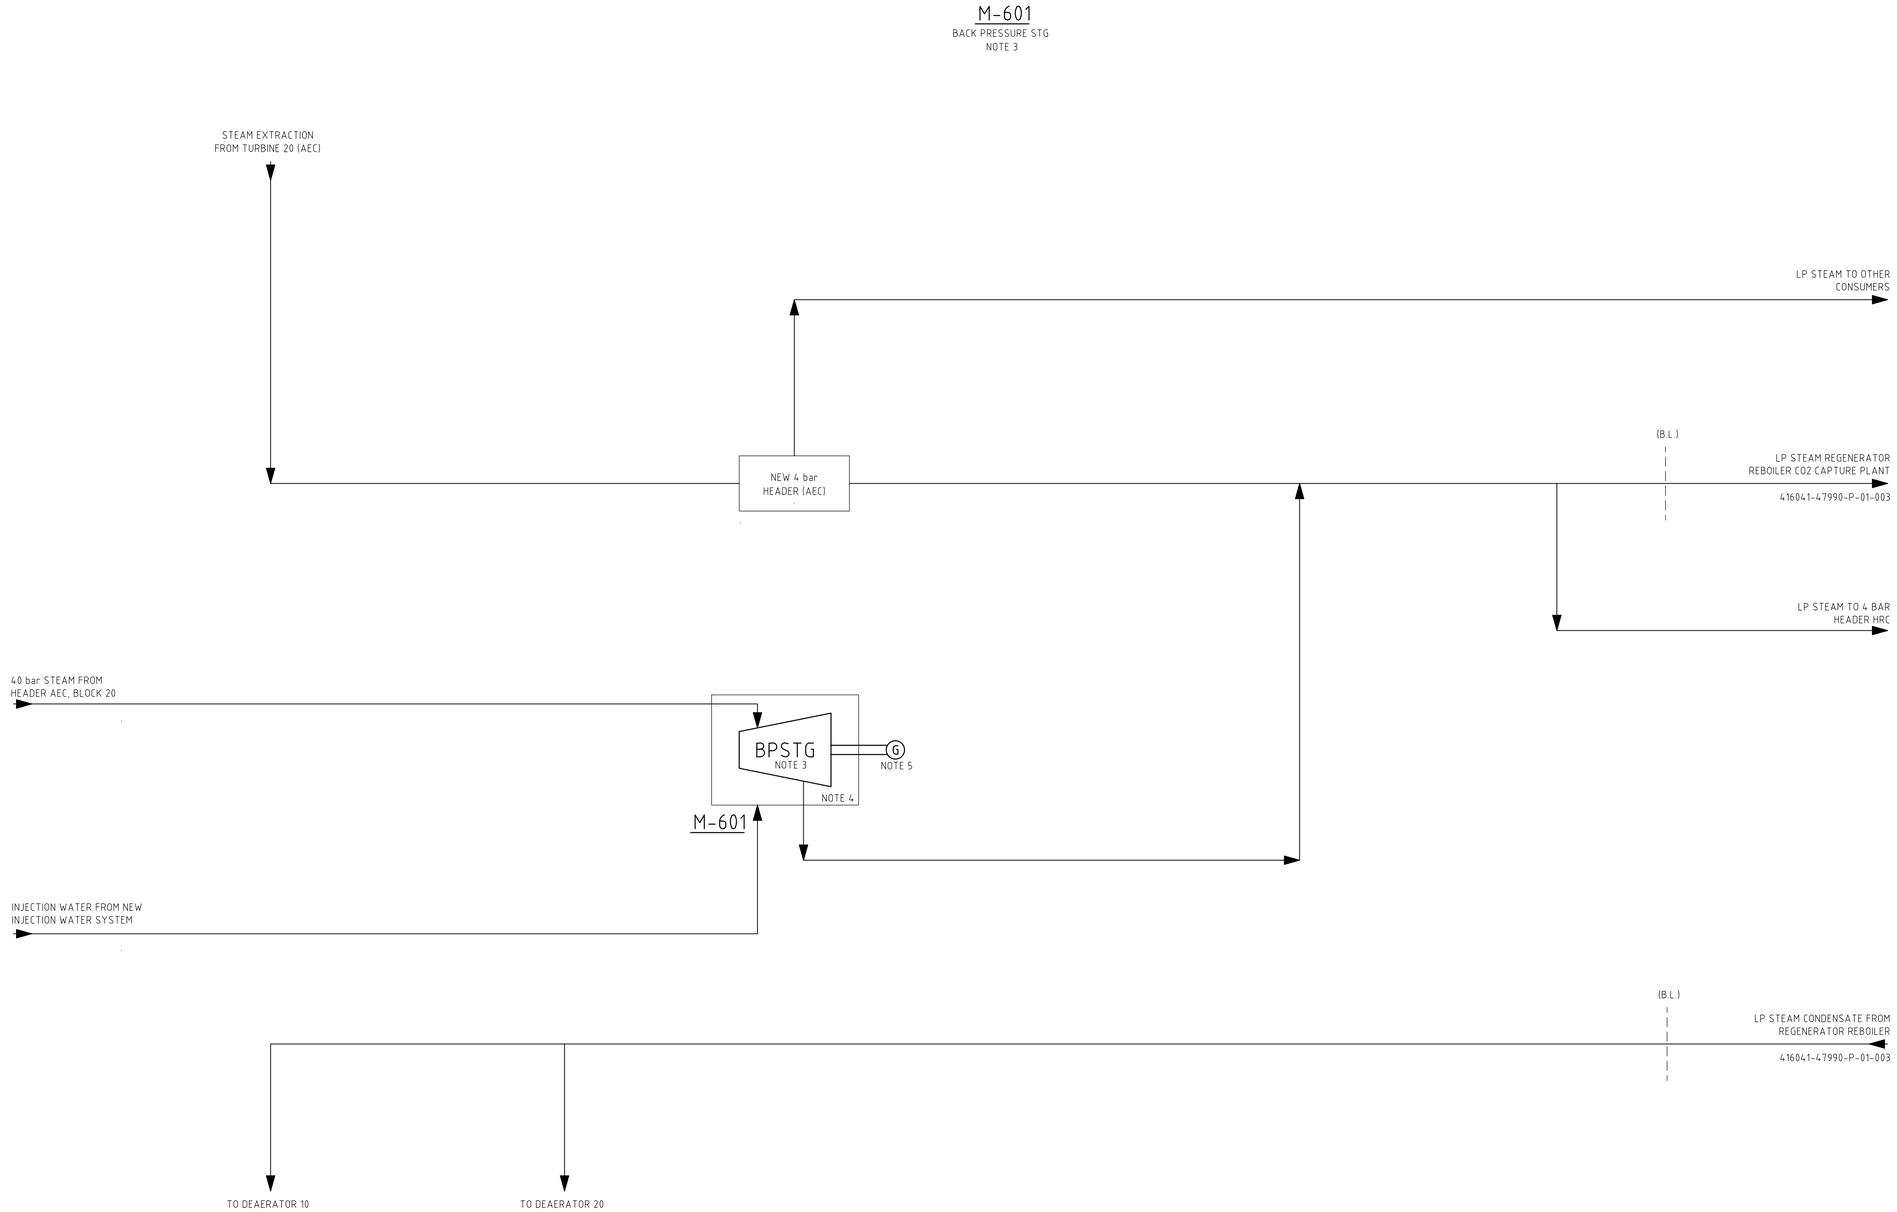

NOTES

1. SUFFICIENT STEAMTRAPS & DRAIN FACILITIES TO BE PROVIDED MAINLY FOR START-UP / SHUT-DOWN.
2. CONDENSATE TO BE DISCHARGED TO FUNNELS,
3. BACK-PRESSURE STG INCLUDING DESUPERHEATER.
4. BACK-PRESSURE TURBINE OPTION IS OUT OF WORLEY SCOPE.
5. STEAM DRIVE COULD BE USED FOR CO2 COMPRESSOR AND/OR FLUE GAS BLOWER. CONTRACTOR TO ADVISE IN THE DESIGN PHASE.

ABBREVIATIONS

AEC	= AFVAL ENERGIE CENTRALE
B.L.	= BATTERY LIMIT
BPSTG	= BACK PRESSURE STEAM TURBINE GENERATOR
ESD	= EMERGENCY SHUT DOWN
HRC	= HOOG RENDEMENT CENTRALE
LP	= LOW PRESSURE

Rev.	Issue Date	Revision Description	Prepared by	Checked by	Disc Appr by	Proj Appr by
C	Aug 2023	Final	SAR	BLGJ	THAX	JOC
B	June 2023	For Client Review	SAR	BLGJ	THAX	JOC
A	April 2023	For Client Review	SAR	BLGJ	THAX	JOC

This drawing is the property of Worley and/or Client and it is loaned with the restriction that the borrower undertakes that it shall not be reproduced, copied, loaned or otherwise disposed of (directly or indirectly) nor used for any purpose other than for which it is specifically provided.

Client/Project Name
AEB
AMSTERDAM, NL

Title
PROCESS FLOW DIAGRAM
LP STEAM SUPPLY & CONDENSATE RETURN

Worley energy | chemicals | resources

Drawing Number 416041-47990-P-01-014

Drawn by SAR | Date Aug 2023 | Drawing Scale NTS | Drawing Size A1 | Sheet 1 of 1 | Issue C

Last saved as : C:\Users\Ray.sauseln\OneDrive - Worley\Documents\%AEB-416041-47990-P-01-014_rev C.dwg Date: 2023-08-02 11:41 Version AutoCAD 23.1 User: Ray.Sauseln