M-901	M-902	M-903	M-904	M-905	M-906	P-901A/B	P-902A/B	P-903A/B	P-904A/B	P-905A/B	P-906A/B	T-901	T-902	T-903	T-904
PRE-FILTER	REVERSE OSMOSIS UNIT	MEMBRANE DEGASSER UNIT	ELECTRO DEIONIZATION UNIT	UV UNIT	ION EXCHANGE UNIT	FEED WATER PUMP FEED PUMPS	TRANSPORT PUMPS	ACID PUMPS	ANTI SCALANT PUMPS	RO FEED PUMPS	DISTRIBUTION PUMPS	BREAK TANK	ACID TANK	ANTI SCALANT TANK	BUFFER TANK

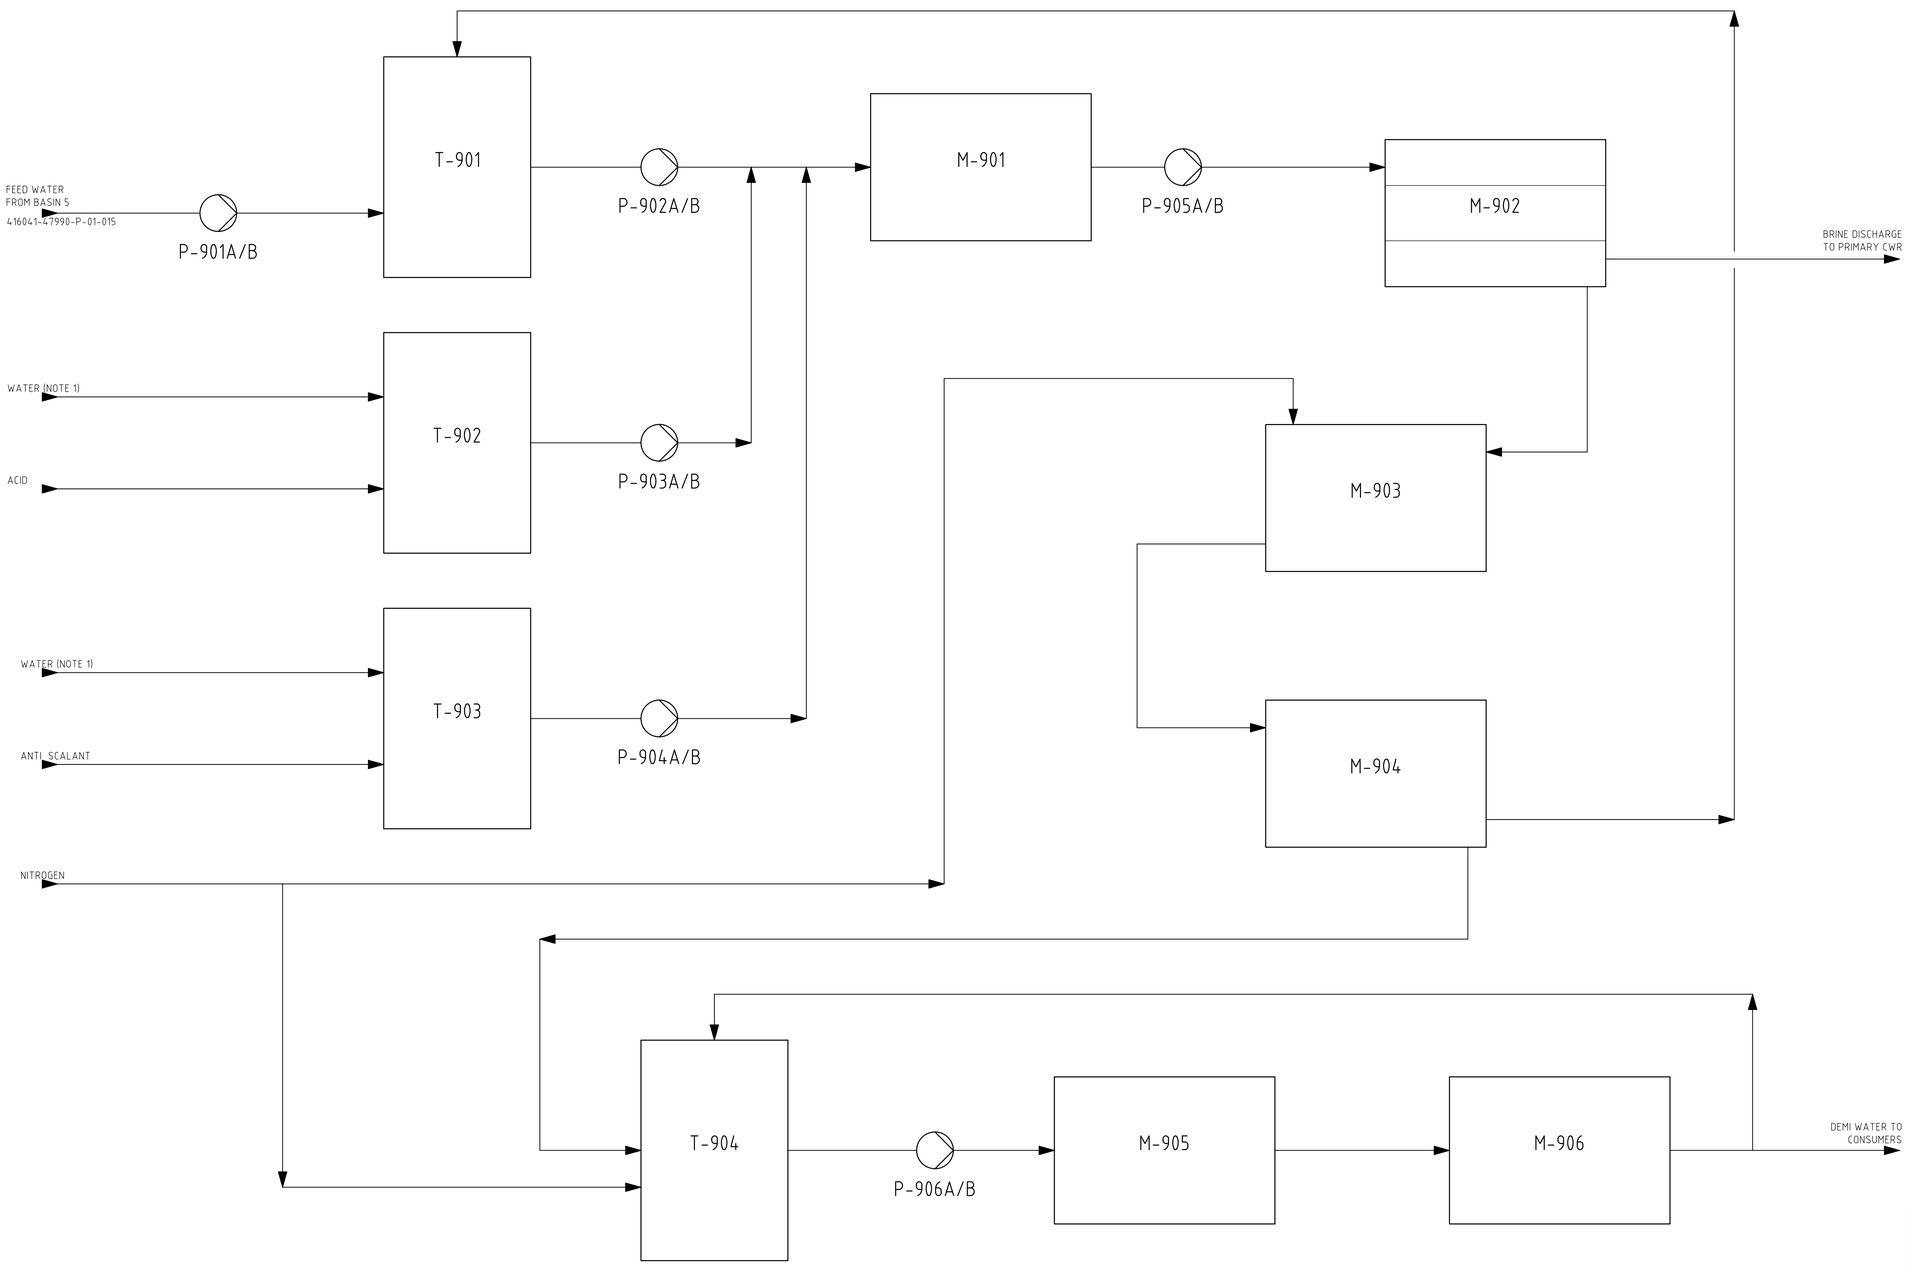

NOTES

1. QUALITY AND SOURCE FOR WATER SUPPLY TO BE CONFIRMED (HOLD).

ABBREVIATIONS

AEC = AFVAL ENERGIE CENTRALE
CWR = COOLING WATER RETURN
HRC = HOOG RENDEMENT CENTRALE
RO = REVERSE OSMOSIS
UV = ULTRA VIOLET

Rev.	Issue Date	Revision Description	Prepared by	Checked by	Disc Appr by	Proj Appr by
A	April 2023	For Client Review	SAR	BLGJ	THAX	JOC

This drawing is the property of Worley and/or Client and it is loaned with the restriction that the borrower undertakes that it shall not be reproduced, copied, loaned or otherwise disposed of (directly or indirectly) nor used for any purpose other than for which it is specifically provided.

Client/Project Name
AEB
AMSTERDAM, NL

Title
PROCESS FLOW DIAGRAM
DEMINERALIZED WATER UNIT

Worley
energy | chemicals | resources

Drawing Number
416041-47990-P-01-017

Drawn by SAR | Date April 2023 | Drawing Scale NTS | Drawing Size A1 | Sheet 1 of 1 | Issue A

Last saved as: C:\Users\Ray.sasonele\OneDrive - Worley\Documents\NAEB-416041-47990\0-tender specs\24-04-2023\WP14\416041-47990-P-01-017.dwg Date: 2023-04-25 11:41 Version AutoCAD 23.1s User Ray.Sasonele