



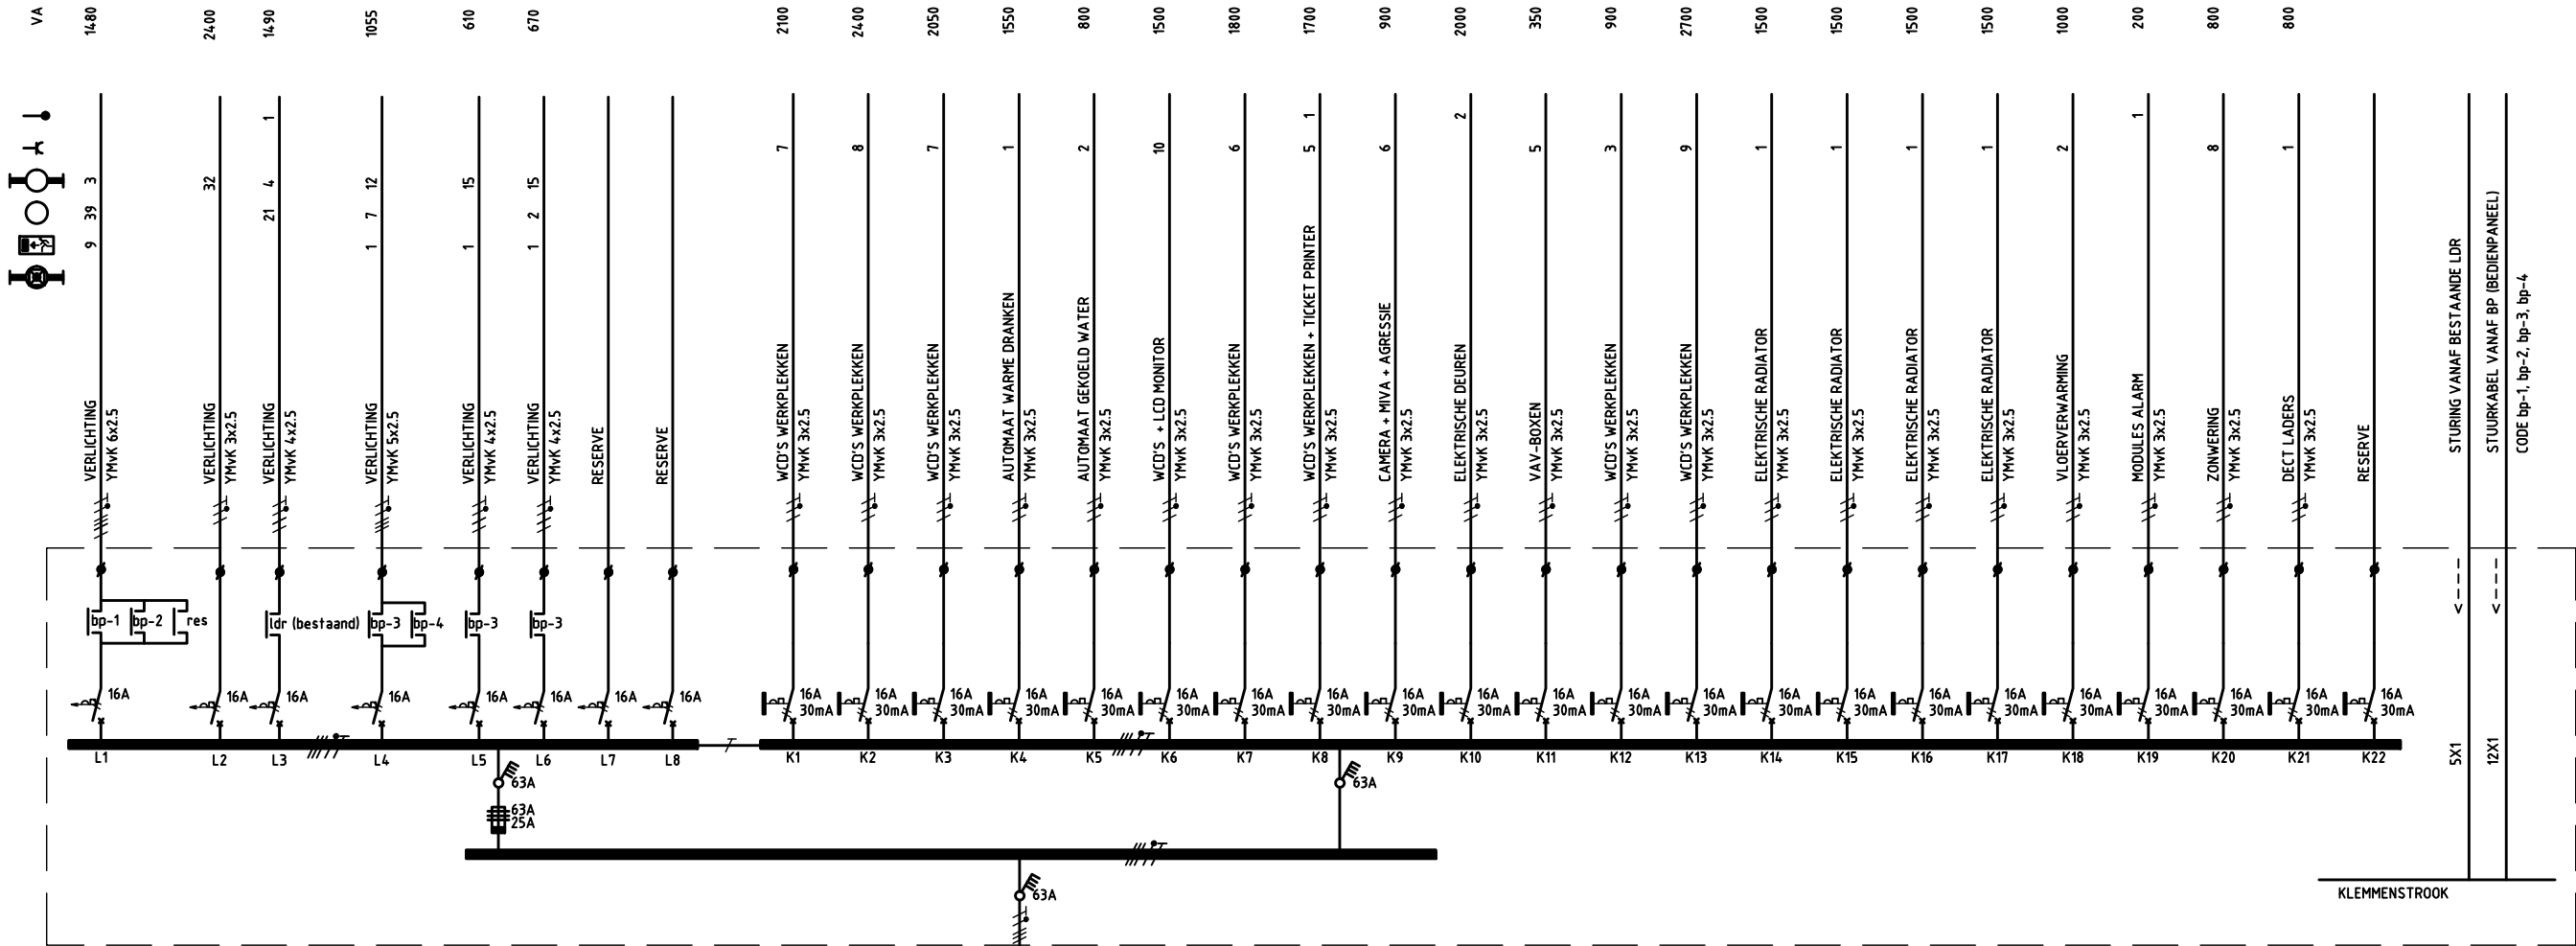

OVK3

RENVOOI

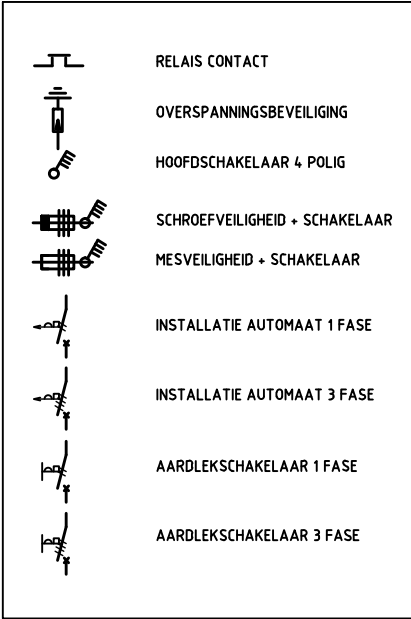

OVK3

3/N 400/230V 50Hz			
Groep	Vermogen	Gelijk (%)	Gelijk (VA)
L1	1480	90	1333
L2	2400	90	2160
L3	1490	90	1341
L4	1055	90	949
L5	610	90	549
L6	670	90	603
K1	2100	100	2100
K2	2400	100	2400
K3	2050	98	2000
K4	1550	50	775
K5	800	50	400
K6	1500	27	400
K7	1800	100	1800
K8	1700	94	1600
K9	900	50	450
K10	2000	50	1000
K11	350	50	175
K12	900	100	900
K13	2700	100	2700
K14	1500	50	750
K15	1500	50	750
K16	1500	50	750
K17	1500	50	750
K18	1000	100	1000
K19	200	50	100
K20	800	50	400
K21	800	50	400
TOTAAL [kVA]	37.3	77	28.5

OPMERKINGEN:
- ALLES OP KLEMMEN UITVOEREN
- 20 % EXTRA KASTRUIMTE RESERVEREN

OPTIE:
- KAST UITVOEREN MET DEUR

Project : VERNIEUWBOUW GEMEENTEHUIS ROERDALEN				Status :	
Installatie : ONDERVERDELER OVK3 BEGANE GROND				REVISIE	
Datum : 07-07-2011	Schaal : N.V.T.	Get. : JOG	Gec. : RJA		
 Technische Installaties bv  een VolkerWessels onderneming			www.homij.nl		
			A ³		Projectnr. : 180115
			File naam : OVK3 03 00		
			Nr.	Gewijzigd	Datum