


RENVOOI



RELAIS CONTACT
OVERSPANNINGSBEVEILIGING
HOOFDSCHAKELAAR 4 POLIG
SCHROEFVEILIGHEID + SCHAKELAAR
MESVEILIGHEID + SCHAKELAAR
INSTALLATIE AUTOMAAT 1 FASE
INSTALLATIE AUTOMAAT 3 FASE
AARDLEKSCHAKELAAR 1 FASE
AARDLEKSCHAKELAAR 3 FASE

OVK8

3/N 400/230V 50Hz			
Groep	Vermogen	Gelijk (%)	Gelijk (VA)
1	1500	70	1050
2	2500	70	1750
3	2200	70	1540
4	2000	70	1400
5	1500	70	1050
6	1500	70	1050
7	1500	70	1050
8	1500	70	1050
9	1500	70	1050
10	2200	70	1540
11	1500	70	1050
13	2500	70	1750
14	2500	70	1750
TOTAAL [kVA]	24.4	70	17.1

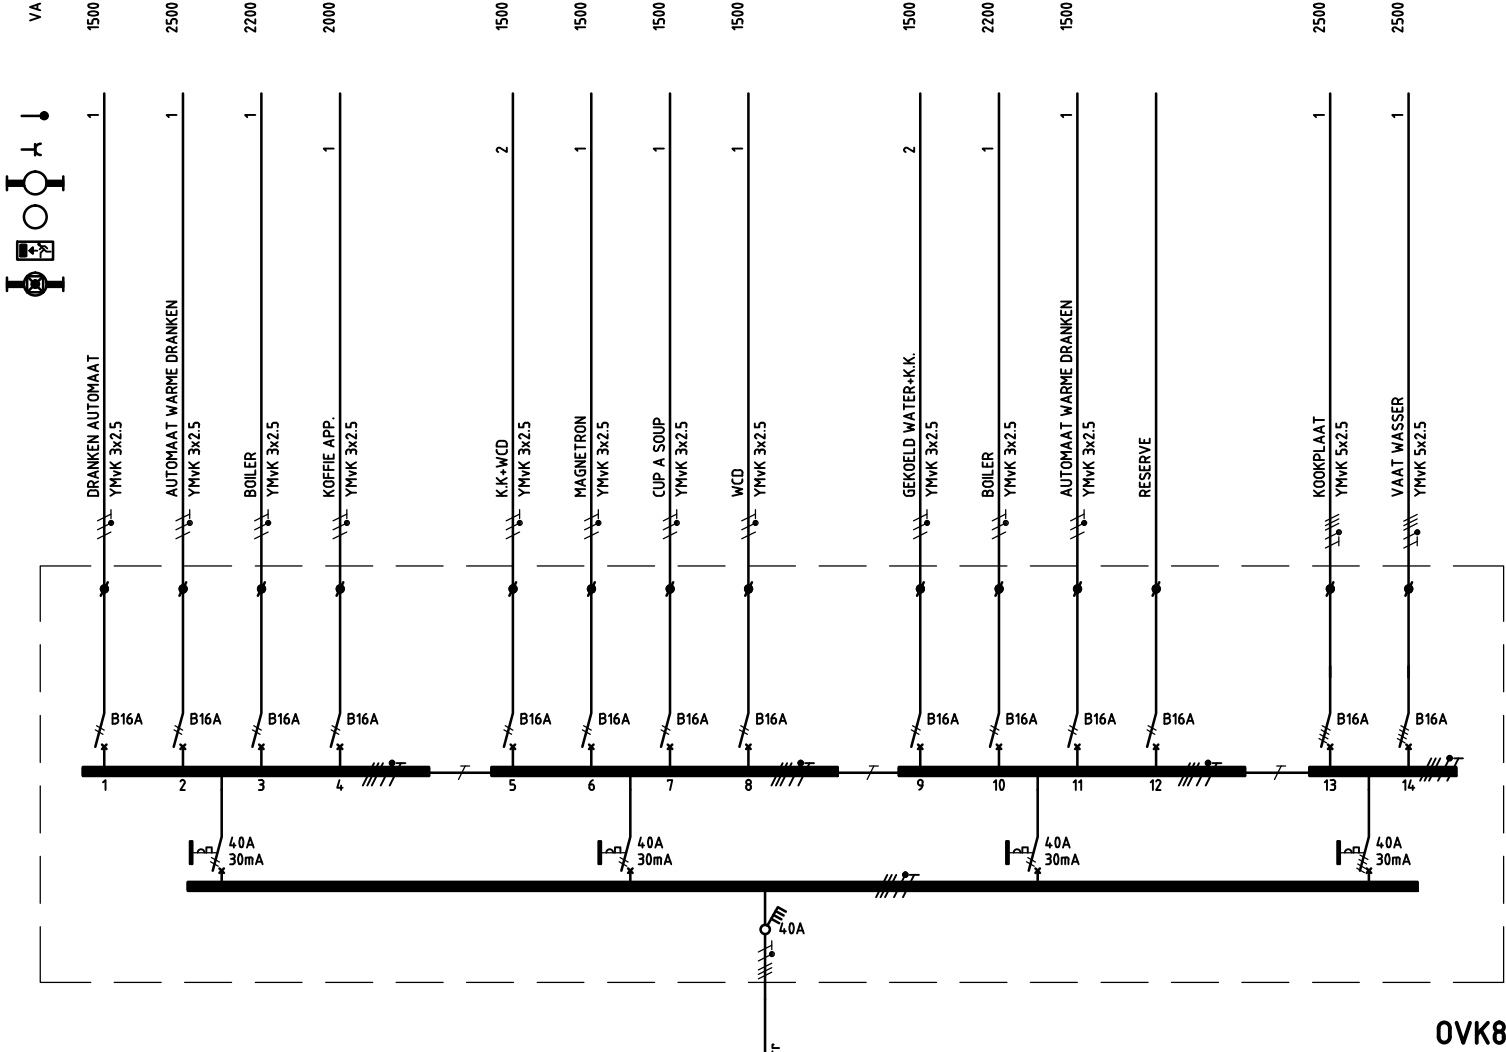

- OPMERKINGEN:
- ALLES OP KLEMMEN UITVOEREN
 - 20 % EXTRA KASTRUIMTE RESERVEREN

- OPTIE:
- KAST UITVOEREN MET DEUR

Project : VERNIEUWBOUW GEMEENTEHUIS ROERDALEN

Installatie : ONDERVERDELER OVK8 BEGANE GROND

Datum : 07-07-2011

Schaal : N.V.T.

Get. : JOG

Gec. : RJA

Status :
REVISIE

www.homij.nl

3

Projectnr. :
180115

File naam :
OVK8 03 00

Nr.

Gewijzigd

Datum

Technische Installaties bv

