


Bijlage

t.b.v Gemaal: Waalhaven ZZ.
Ontwerpfase: Bestek

PERSLEIDINGEN EVERLO EN WAALHAVEN ZZ NAAR DOKHAVEN

Uitgangssituatie gemaal Everlo

nummer.	lengte	diameter	diameter	materiaal	k _(max)	Q _{d.w.a.}	V _{leiding}	Q _{r.w.a.}	V _{leiding}	Q _{O.B.}	V _{leiding}
	[m]	uitwendig [mm]	inwendig [mm]		[mm]	[m³/h]	[m/s]	[m³/h]	[m/s]	[m³/h]	[m/s]
Gemaal Waalhaven ZZ G037											
0	1040	500	426	PE	0.5	210	0.41	1200	2.34	1200	2.34
Gemaal Everlo G024											
1	10		609	St	2	600	0.57	1800	1.72	1800	1.72
2	107		556	PE	0.5	600	0.69	1800	2.06	1800	2.06
3	1412		626	PE	0.5	600	0.54	1800	1.63	1800	1.63
4	22		710	St	2	600	0.42	1800	1.26	1800	1.26
5	87		626	PE	0.5	600	0.54	1800	1.63	1800	1.63
6	180		605	PE	0.5	600	0.58	1800	1.74	1800	1.74
Inprikpunt Waalhaven ZZ G037											
7	53		900	St	2	810	0.35	3000	1.31	3000	1.31
8	1866		626	PE	0.5	810	0.73	3000	2.71	3000	2.71
Aftakking AWZI											
9	183		609	St	2	810	0.77	3000	2.86		
Aftakking OB											
10	39		609	St	2					3000	2.86
11	27		808	St	2					3000	1.63
12	277		609	PE	0.5					3000	2.86

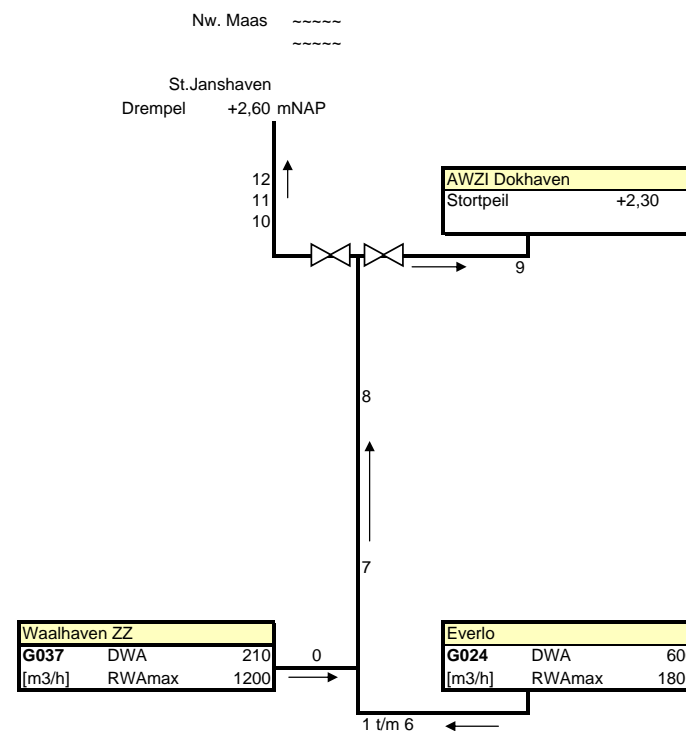

Gewijzigd: 6-1-2010
Geprint: 1-7-2011